LIGHTING FIXTURE SCHEDULE

TYPE	DESCRIPTION	DIMENSION	MOUNTING	COLOR TEMP.	LUMENS	VOLTS	DIMMING	MANUFACTURER & CAT. NO. (OR APPROVED EQUAL)	LOADS WATT	LOADS VA
AA	LED LOW PROFILE RECTANGLE SHAPED LUMINAIRE, POLE MTD., IP66 RATED, DIE CAST ALUMINUM HOUSING, TYPE 3 OPTICS, WITH INTERNAL SHIELD. POLE SHALL BE 25' STRAIGHT SQUARE ALUMINUM, .188" WALL THICKNESS, BRONZE PAINTED, BASE MOUNTED, WITH BASE COVER AND ANCOR BOLTS.	27" x 15" x 5" 25' TALL	POLE BASE	4000K	17,000	208	NONE	LUMINAIRE: GARDCO ECF-S-48L-900-NW-G2-AR-3-UNV-BZ LITHONIA RSX2LED-P2-40K-R3-SPA-DDBXD POLE: GARDCO SSA-STB-5-188-25-D1-BZ LITHONIA SSA-25-5G-DM19AS-FBC-DDBXD	112	118
BB	LED LOW PROFILE RECTANGLE SHAPED LUMINAIRE, 2 LUMINAIRES MOUNTED AT 180 DEGREES, POLE MTD., IP66 RATED, DIE CAST ALUMINUM HOUSING, TYPE 3 OPTICS, WITH POLE SHALL BE 25' STRAIGHT SQUARE ALUMINUM, .188" WALL THICKNESS, BRONZE PAINTED, BASE MOUNTED, WITH BASE COVER AND ANCOR BOLTS.	27" x 15" x 5" 25' TALL	POLE BASE	4000K	17,000	208	NONE	LUMINAIRE: (2) GARDCO ECF-S-48L-900-NW-G2-AR-3-UNV-BZ (2) LITHONIA RSX2LED-P2-40K-R3-SPA-DDBXD POLE: GARDCO SSA-STB-5-188-25-D1-BZ LITHONIA SSA-25-5G-DM29AS-FBC-DDBXD	224	236
CC	LED LOW PROFILE RECTANGLE SHAPED LUMINAIRE, POLE MTD., IP66 RATED, DIE CAST ALUMINUM HOUSING, TYPE 4 OPTICS, WITH INTERNAL SHIELD. POLE SHALL BE 25' STRAIGHT SQUARE ALUMINUM, .188" WALL THICKNESS, BRONZE PAINTED, BASE MOUNTED, WITH BASE COVER AND ANCOR BOLTS.	27" x 15" x 5" 25' TALL	POLE BASE	4000K	17,000	208	NONE	LUMINAIRE: GARDCO ECF-S-48L-900-NW-G2-AR-4-UNV-BZ LITHONIA RSX2LED-P2-40K-R4-SPA-DDBXD POLE: GARDCO SSA-STB-5-188-25-D1-BZ LITHONIA SSA-25-5G-DM19AS-FBC-DDBXD	112	118
DD	LED EXTERIOR WEDGE SCONCE, WET LOCATION, INTEGRAL ALUMINUM HEAT SINK, BRONZE COLOR DIECAST ALUMINUM HOUSING, VISUAL COMFORT LENS, WITH TYPE 3 DISTRIBUTION AND CUTOFF OPTICS.	12" x 9" x 7"	WALL	4000K	3200	120	NONE	LITHONIA WEDGE2-P3-40K-80CRI-T3M-DDBXD	32	34

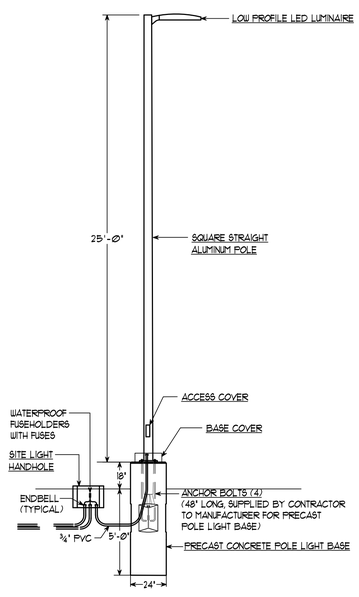

DETAIL - PARKING LOT POLE, BASE & LUMINAIRE

SCALE: ¼" = 1'-0"

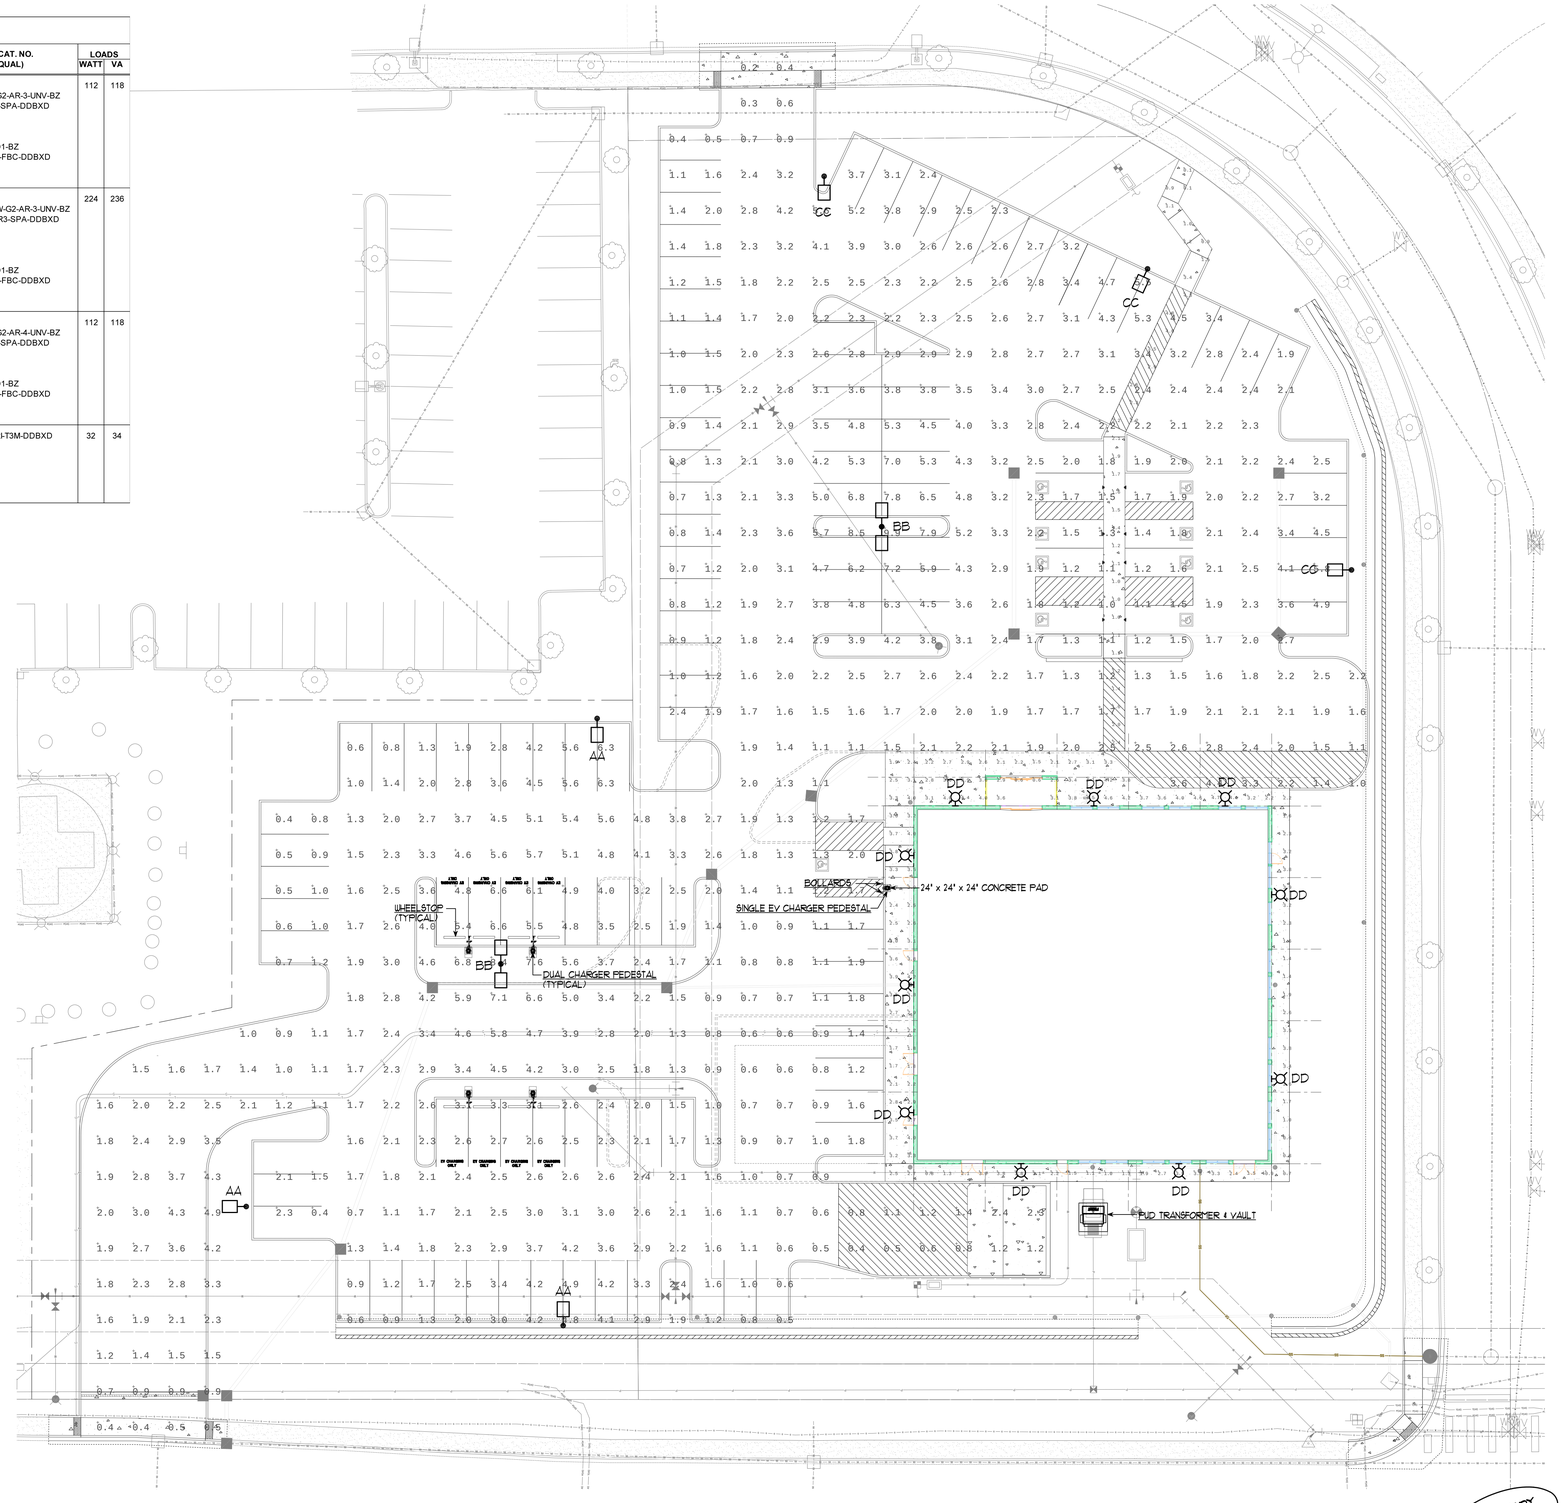

1 ELECTRICAL - SITE PLAN

SCALE: 1" = 20'-0"

NORTH

0 10' 20' 40'

SCALE: 1"=20'

PRELIMINARY 10-1-25

K ENGINEERS INC.
208 Third Street
Lynden, WA. 98264
Bus. (360) 354-4757
FAX (360) 354-6794

ISSUE RECORD

No.	DATE	DESCRIPTION

Skagit Regional Health

VISCONSI COMPANIES, LTD.

MEDICAL CENTER
XXXX 212TH STREET NE
Arlington, Washington 98223

WILLIAM R. DIEHLUS STATE OF WASHINGTON 44794 REGISTERED PROFESSIONAL ENGINEER 9/24/25

INVESTIGATION BY: BD	DRAWN BY: BD
DATE: 10/1/2025	APPROVED BY: BD
SCALE: As Noted	FILE NAME: E1.1
PROJECT No: 2450	

SHEET TITLE: Electrial - Site & Photometric Plan

SHEET NUMBER: E1.1